产品规格书
Product Specification

- 产 品 名 称 ： QC4.10(PLUS)连接器

  Product Name: QC4.10（PLUS）connector

- 客 户 名 称 ：

  Customer Name：

- 供　 应　 商 ： QC Solar

  Vendor：QC Solar

承　认　签　章（Confirmation）					
快可承认（QC Solar confirmation）			客户承认（Customer confirmation）		
批准 Approved by	审核 Audited by	设计 Designed by	采购 Purchased by	品保 Quality Assured by	技术 Technical verified by

苏州快可光伏电子股份有限公司
QC SOLAR (SUZHOU) CORPORATION
中国苏州工业园区新发路 31 号
No.31,Xinfa road, SIP, Suzhou, China
TEL : 0512-62603391　FAX :0512-62603396

目录 Catalog

1. 产品外观及设计性能参数要求 Product appearance and design performance parameters.....2

2. 连接器 BOM 清单 BOM of connector.....3

3. 连接器图纸 Drawing of connector..... 4-5

4. 连接器 TUV 证书 TUV certification of connector..... 6-7

5. 连接器 UL 证书 UL certification of connector.....8

1. 产品外观及设计性能参数要求：Product appearance and design

TUV 证书编号 TUV certificate number: R50505605（莱茵）/B 077362 0004 Rev 05（南德）

UL 证书编号 UL certificate number：E340004

额定电压 Rated Voltage：IEC1500V/UL1500V

额定电流 Rated current：36A ，41A，46A(2.5 mm²/14AWG、4mm²/12AWG、6mm²/10AWG)

接触电阻 Contact resistance：≤0.3mΩ

环境温度 Temperature range：-40℃∽+85℃

连接器分断力 Breaking force：≥80N

寿命测试插拔 Life test plug：50 次

IP 等级 Protection Degree：IP68（1m,1h）

2. 连接器 BOM 清单 Connector BOM List：

QC Solar (Suzhou) Corporation					
产品名称 **Product name**	Connector	材料清单 Bill Of Materials		版　本 **Version**	A/0
产品型号 **Product**	QC4.10（Plus）			张　数 Paper	1
客 户 **Customer**				发行日期 **Issue date**	2022.06.28
序号 No.	名　称	材　质	生产厂商	数　量	备　注
1	正极本体 Female housing	PPE	QC Solar	1 pcs	
2	负极本体 Male housing	PPE	QC Solar	1 pcs	
3	后罩 Cable clamp	PA	QC Solar	2 pcs	
4	内爪 Screw cap	PA	QC Solar	2 pcs	
5	堵头 Sealing gasket	硅橡胶 Silicon rubber	QC Solar	2 pcs	规格一:4.7-6.0 规格二:5.6-6.8 规格三:6.0-7.2
6	红色 O 型圈 O sealing ring	硅橡胶 Silicon rubber	QC Solar	1 pcs	
7	插针-1500V Metal plug	铜镀锡 Tin-plated copper	QC Solar	1 pcs	
8	插套-1500V Metal socket	铜镀锡 Tin-plated copper	QC Solar	1 pcs	
以上原料符合欧盟 ROHS 要求					
制表：		审核：		批准：	

SUNERSYS

3. 连接器图纸 Drawing of connector:

NO.	Name	Specification	Quantity
1	Cable Nut	/	2PCS
2	Hook	/	2PCS
3	Gasket	/	2PCS
4	Female Housing	/	1PCS
5	Terminal 1	/	1PCS
6	O ring	/	1PCS
7	Terminal 2	/	1PCS
8	Male Housing	/	1PCS

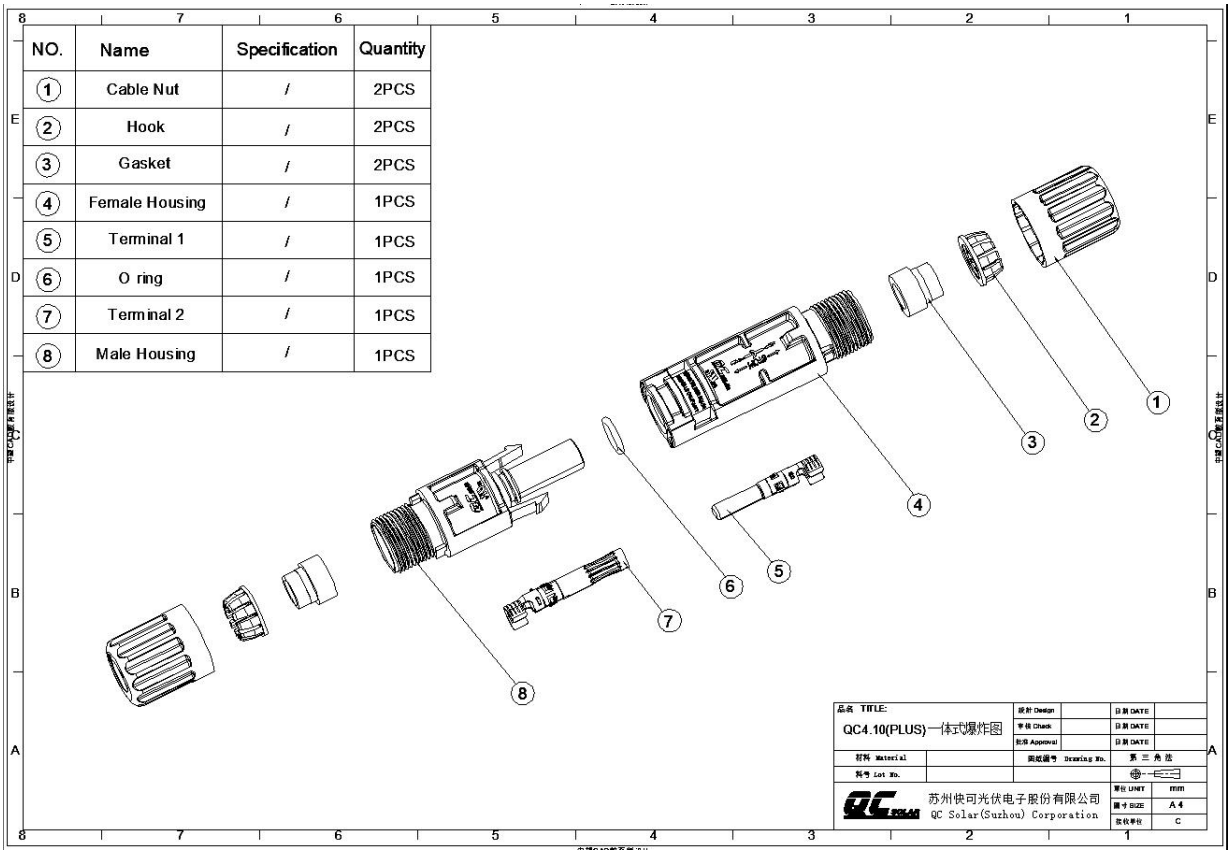

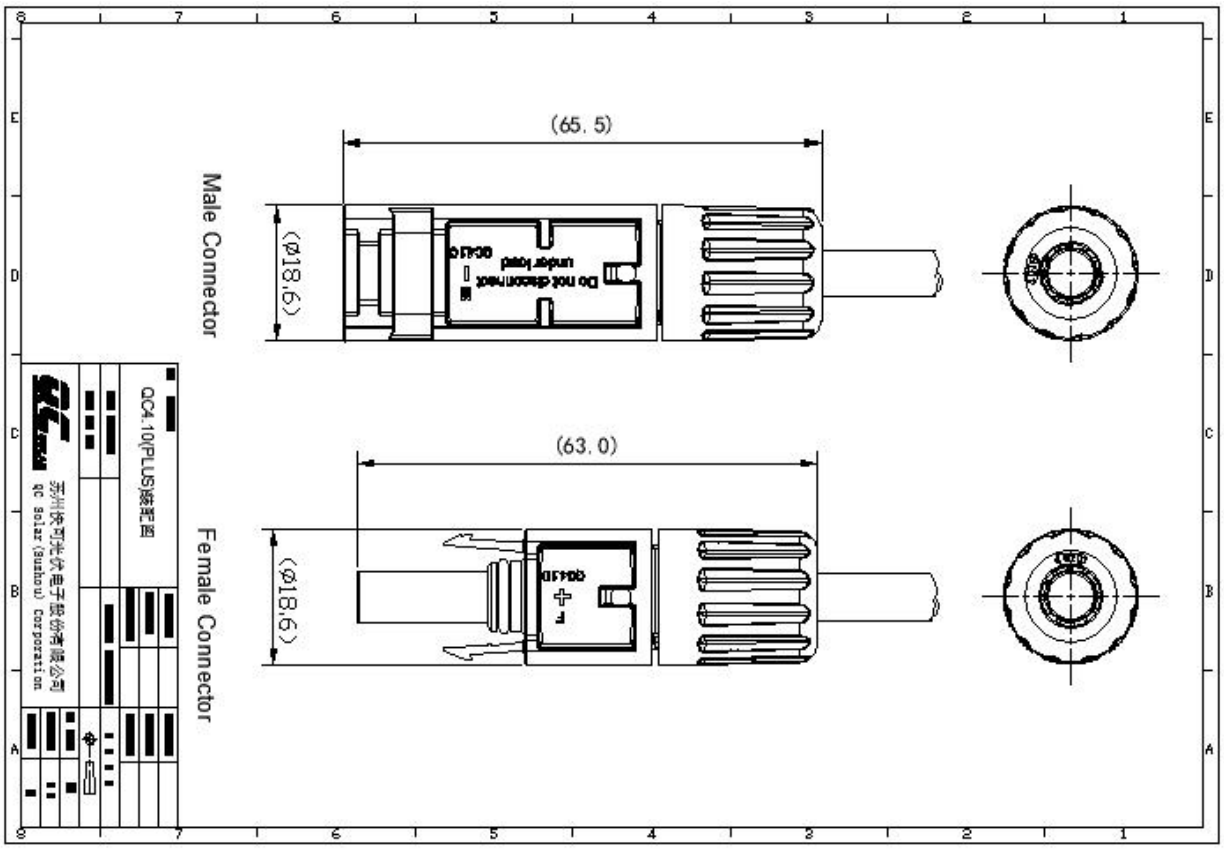

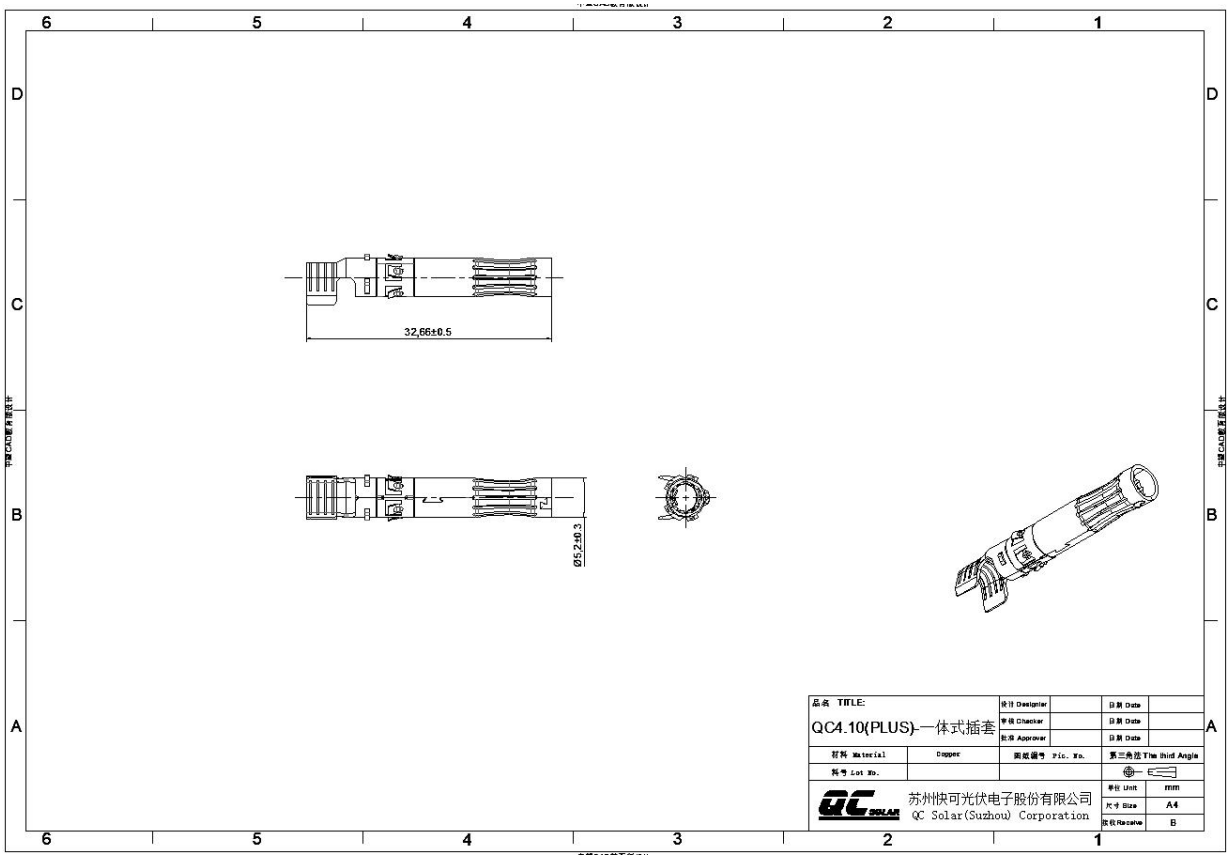
32,66±0.5
Ø5,2±0.3
品名 TITLE:
QC4.10(PLUS)-一体式插套
材料 Material
Copper
料号 Lot No.
苏州快可光伏电子股份有限公司
QC Solar(Suzhou) Corporation
单位 Unit
mm
尺寸 Size
A4

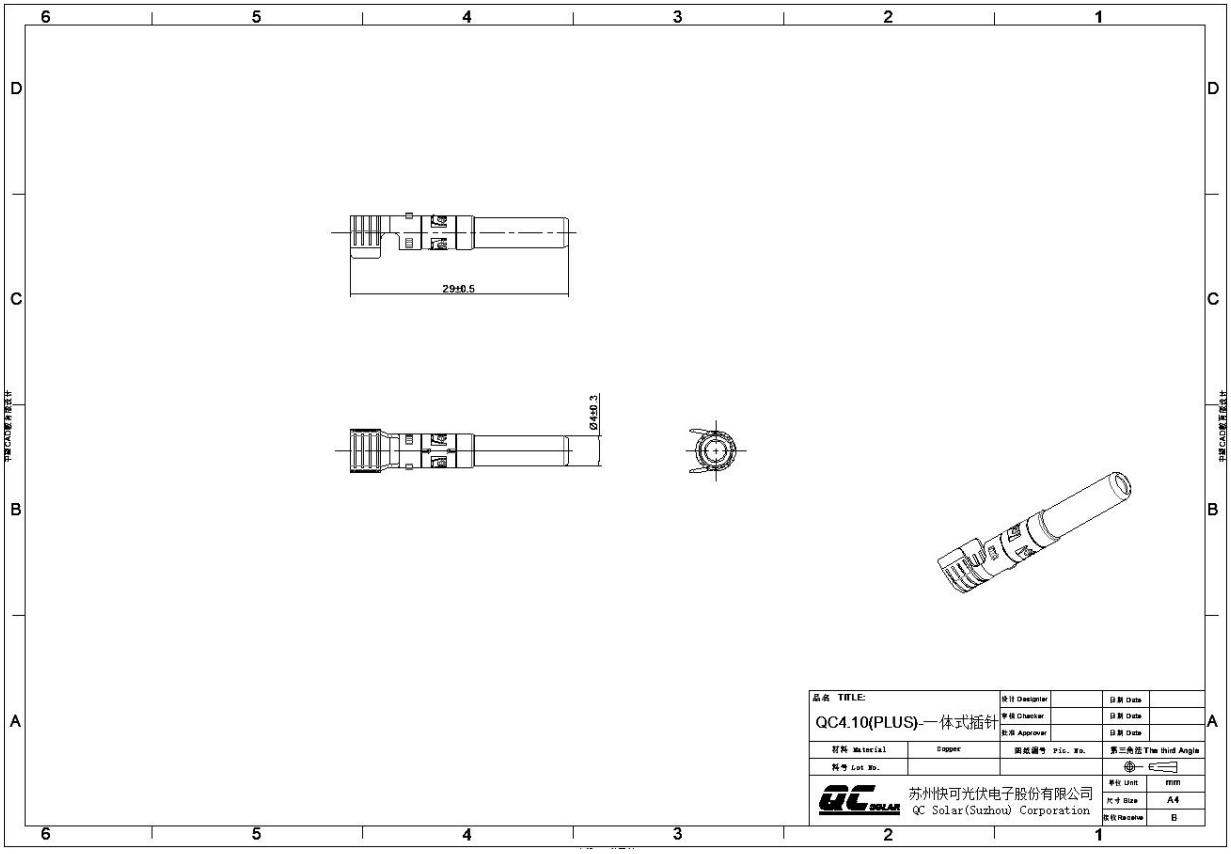
29±0.5
Ø4±0.3
品名 TITLE:
QC4.10(PLUS)-一体式插针
材料 Material
Copper
料号 Lot No.
苏州快可光伏电子股份有限公司
QC Solar(Suzhou) Corporation
单位 Unit
mm
尺寸 Size
A4

4. 连接器 TUV 证书 TUV certification of connector:

（1）莱茵

Zertifikat ***Certificate***

TÜVRheinland®

Zertifikat Nr. *Certificate No.* R 50505605 | **Blatt** *Sheet* 0001

Ihr Zeichen *Client Reference*	Unser Zeichen *Our Reference*	Ausstellungsdatum	*Date of Issue*
F.G.Y.	01-ZQI-CN21LJLT 001	02.06.2021	*(day/mo/yr)*

Genehmigungsinhaber *License Holder*
QC Solar (Suzhou) Corporation
No. 31, Xinfa Road, SIP
Suzhou
215123 Jiangsu
P.R. China

Fertigungsstätte *Manufacturing Plant*
Refer to latest revision
of the annex list of factories

Prüfzeichen *Test Mark*
TÜVRheinland ZERTIFIZIERT — Bauart geprüft, Sicherheit, Regelmäßige Produktions-überwachung, www.tuv.com ID 1111240433

Geprüft nach *Tested acc. to*
IEC 62852:2014+A1
EN 62852:2015+A1

Zertifiziertes Produkt (Geräteidentifikation) *Certified Product (Product Identification)* | **Lizenzentgelte - Einheit** *License Fee - Unit*

PV Komponente (elektrisch) für BOS (PV Components for BOS - electrical)

Type Designation : QC4.10-cds(c=3 or 4; d=4, 5, 6) ; (7 or 8; s=blank or 1) (QC) — 25

Rated Voltage : 1500VDC
Rated Current : 36A for QC4.10-34; QC4.10-44;
41A for QC4.10-35; QC4.10-45;
46A for QC4.10-36; QC4.10-46;
46A for QC4.10-37; QC4.10-47;
55A for QC4.10-38; QC4.10-48;
36A for QC4.10-341; QC4.10-441;
41A for QC4.10-351; QC4.10-451;
46A for QC4.10-361; QC4.10-461
Ambient Temperature : -40°C to +85°C
Upper Limit Temperature: 100°C

Continued on page 0002

25

ANLAGE (Appendix): 1.0

Dem Zertifikat liegt unsere Prüf- und Zertifizierungsordnung zugrunde und es bestätigt die Konformität des Produktes mit den oben genannten Standards und Prüfgrundlagen. Zusätzliche Anforderungen in Ländern, in denen das Produkt in Verkehr gebracht werden soll, müssen zusätzlich betrachtet werden. Die Herstellung des zertifizierten Produktes wird überwacht.
This certificate is based on our Testing and Certification Regulation and states the conformity of the product with the standards and testing requirements as indicated above. Any additional requirements in countries where the product is going to be marketed have to be considered additionally. The manufacturing of the certified product is subject to surveillance.

Zertifizierungsstelle — TÜV Rheinland LGA Products GmbH

TÜV Rheinland LGA Products GmbH, Tillystraße 2, 90431 Nürnberg
Tel.: +49 221 806-1371 e-mail: cert-validity@de.tuv.com
Fax: +49 221 806-3935 http://www.tuv.com/safety

Paulus Hou

TÜV, TUEV and TUV are registered trademarks. Utilisation and application requires prior approval.

（2）南德

ZERTIFIKAT ◆ CERTIFICATE ◆ 認證證書 ◆ СЕРТИФИКАТ ◆ CERTIFICADO ◆ CERTIFICAT

Product Service

CERTIFICATE

No. B 077362 0004 Rev. 05

Holder of Certificate: **QC Solar (Suzhou) Corporation**
No.31, Xinfa Road, SIP.
215123 Suzhou
PEOPLE'S REPUBLIC OF CHINA

Certification Mark:

Product: **Connector**

Connectors for Photovoltaic Systems

Model(s): **QC4.10-ab, QC4.3, QC4.Y, QC4.D,QC4.10-cds**

Parameters:

Rated Voltage:	Up to 1500VDC for QC4.3, QC4.Y,QC4.D Up to 1100VDC for QC4.10-ab, 1500VDC for QC4.10-cds
Rated Current:	30A or 35A or 40A for QC4.10-ab 36A or 41A or 46A or 42A or 55A or 60A for QC4.10-cds 30A for QC4.3 50A for QC4.Y 3A for QC4.D
Application Class	A
Protection Class:	II
Degree of Protection:	IP65/IP68(1m,1h) for QC4.10-ab, QC4.10-cds IP65/IP68(1m,1h) for QC4.Y IP65IP68(1m,24h) for QC4.D IP65/IP67 for QC4.3
Ambient Temperature:	-40°C ~ +85°C

Tested according to: IEC 62852:2014
IEC 62852:2014/AMD1:2020
EN 62852:2015/A1:2020

The product was tested on a voluntary basis and complies with the essential requirements. The certification mark shown above can be affixed on the product. It is not permitted to alter the certification mark in any way. In addition, the certification holder must not transfer the certificate to third parties. This certificate is valid until the listed date, unless it is cancelled earlier. All applicable requirements of the testing and certification regulations of TÜV SÜD Group have to be complied. For details see: www.tuvsud.com/ps-cert

Test report no.: 704071715901-05
Valid until: 2026-08-08

Date, 2021-08-09

(Yaqun Alex Liu)

TÜV®

Page 1 of 1
TÜV SÜD Product Service GmbH • Certification Body • Ridlerstraße 65 • 80339 Munich • Germany

5. 连接器 UL 证书 ULcertification of connector:

UL Product iQ™

QIJQ2.E340004 - Connectors for Use in Photovoltaic Systems - Component

Connectors for Use in Photovoltaic Systems - Component

QC SOLAR (SUZHOU) CORP
31 XINFA RD
SIP
SUZHOU, JIANGSU 215123 China

E340004

Cat. No.	Electrical Rating
Photovoltaic wiring-system connector	
QC4 series	600 V dc, with 10-14 AWG PV cable, 30A dc maximum
Series QC4.10, followed by -a3, followed by c1, followed by d1, d2 or d3, may be followed by e1 or e2. QC4.6-6.0	600 V dc, with 10 AWG PV cable, 30 A dc
Series QC4.10, followed by -a3, followed by c2 or c3, followed by d1, d2 or d3, may be followed by e1 or e2. QC4.6-4.0	600 V dc, with 12 AWG PV cable, 20 A dc
Series QC4.10, followed by -a3, followed by c4, followed by d1, d2 or d3, may be followed by e1 or e2. QC4.6-2.5	600 V dc, with 14 AWG PV cable, 15 A dc
Series QC4.10, followed by -a4, may be followed by b1, followed by c6, followed by d1, d2 or d3, may be followed by e1 or e2.	1000 V dc, with 10 AWG PV cable, 30 A dc
Series QC4.10, followed by -a4, may be followed by b1, followed by c7, c8 or c10, followed by d1, d2 or d3, may be followed by e1 or e2.	1000 V dc, with 12 AWG PV cable, 20 A dc
Series QC4.10, followed by -a4, may be followed by b1, followed by c9, followed by d1, d2 or d3, may be followed by e1 or e2.	1000 V dc, with 14 AWG PV cable, 15 A dc
Models QC4.10-a5BCDEF series, where B can be b1 or none, C can be c15, D can be d1, d3 or d4, E can be e2, e3 or e4, and F can be none or f1.	1500 V dc, with 14 AWG PV cable, 30 A dc

Models QC4.10-a5BCDEF series, where B can be b1 or none, C can be c12, D can be d1, d3 or d4, E can be e2, e3 or e4, and F can be none or f1.	1500 V dc, with 12 AWG PV cable, 35 A dc
Models QC4.10-a5BCDEF series, where B can be b1 or none, C can be c13, D can be d1, d3 or d4, E can be e2, e3 or e4, and F can be none or f1.	1500 V dc, with 12 AWG PV cable, 35 A dc
Models QC4.10-a5BCDEF series, where B can be b1 or none, C can be c14, D can be d1, d3 or d4, E can be e2, e3 or e4, and F can be none or f1.	1500 V dc, with 10 AWG PV cable, 50 A dc
QC4.3-ab1	1000 V dc, with 10 AWG PV cable, 30 A dc
QC4.3-ab2	1000 V dc, with 12 AWG PV cable, 20 A dc
QC4.3-ab3	1000 V dc, with 14 AWG PV cable, 15 A dc

Marking: Company name or trademark "QC", catalog designation and the Recognized Component Mark on the device or carton.

Last Updated on 2021-09-07

The appearance of a company's name or product in this database does not in itself assure that products so identified have been manufactured under UL's Follow-Up Service. Only those products bearing the UL Mark should be considered to be Certified and covered under UL's Follow-Up Service. Always look for the Mark on the product.

UL permits the reproduction of the material contained in the Online Certification Directory subject to the following conditions: 1. The Guide Information, Assemblies, Constructions, Designs, Systems, and/or Certifications (files) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings). 2. The statement "Reprinted from the Online Certifications Directory with permission from UL" must appear adjacent to the extracted material. In addition, the reprinted material must include a copyright notice in the following format: "© 2021 UL LLC"